

February 16, 2007


Wendell Floyd
Dunbarton Corporation
868 Murray Road
Dothan, AL 36303

Dear Wendell:

This letter is in response to your question about the installation of Category A and Category B Positive Pressure Fire Doors into your listed and labeled fire door frames. Your frames are listed and eligible for labeling for use in positive pressure door assemblies. Your frames have been tested and approved for use with both Category A and Category B Positive Pressure Fire Doors. For the Category A doors no additional edge seals are required. For Category B doors an additional Category G Edge Seal would be required per the installation instructions of the edge seal. Also note your frames meet the requirements for the "S" mark if and only if a listed Category H Smoke and Draft Control Gasket is applied. Your frames have also been tested and approved for labeling with both composite core (wood or laminate faced) doors and steel faced doors with rating up to 90 minutes (1-1/2 hours).

Please feel to contact us if you have any questions or comments.

Sincerely,

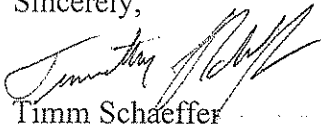

Timm Schaeffer
Engineer / Inspection Manager

